DELPHI SYSTEMS CORP.

CORRECTIVE MEASURES PROPOSAL

FIGURE 28

Figure 28: Soil Samples Exceeding Soil Human-Health and/or Groundwater Protection Criteria - West

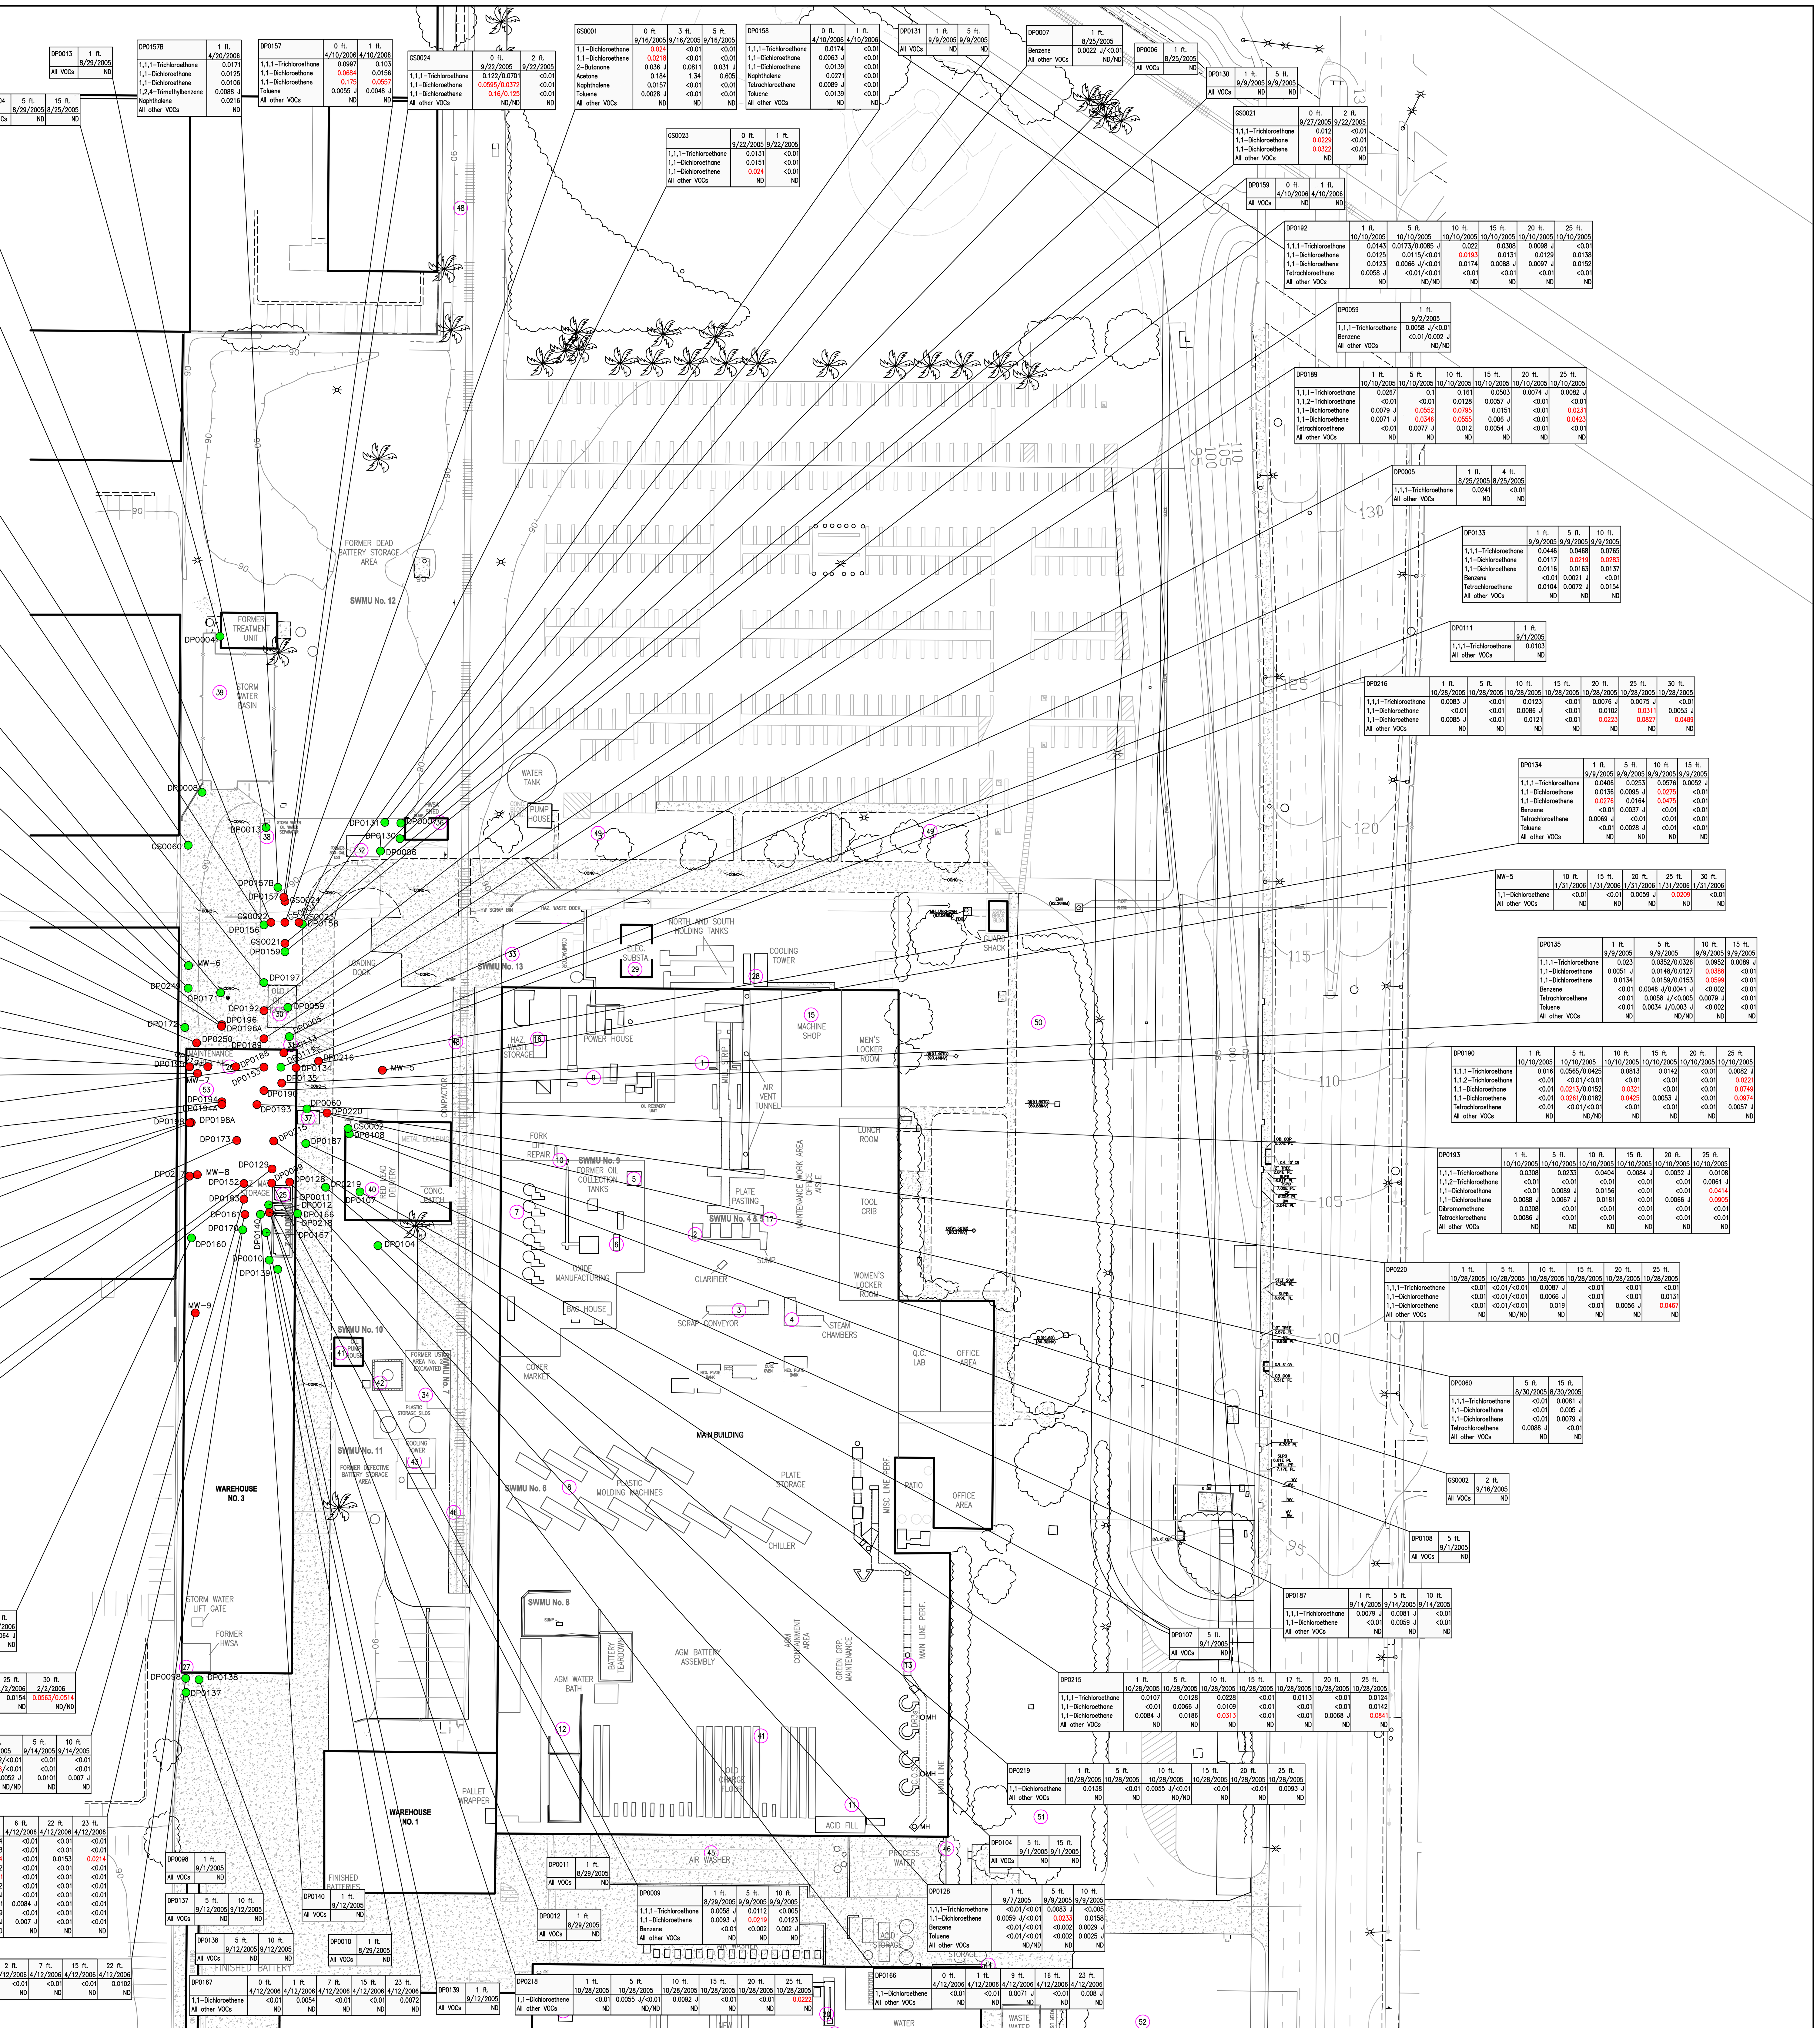

GS0022	0 ft. 9/22/2005	2 ft. 9/22/2005
1,1,1-Trichloroethane	0.0094 J	<0.01
1,1-Dichloroethane	0.0152	<0.01
1,1-Dichloroethene	0.0215	<0.01
All other VOCs	ND	ND

DP0156	0 ft. 4/10/2006	1 ft. 4/10/2006
1,1-Dichloroethene	0.0094 J	<0.01
All other VOCs	ND	ND

DP0008	5 ft. 8/25/2005	15 ft. 8/25/2005	15 ft. 8/29/2005
All VOCs	ND	ND	ND

GS0060	0 ft. 5/30/2006	1 ft. 5/30/2006	2 ft. 5/30/2006
All VOCs	ND	ND	ND

DP0197	1 ft. 10/11/2005	5 ft. 10/11/2005	15 ft. 10/11/2005
All VOCs	ND	ND	ND

DP0171	1 ft. 3/31/2006	6 ft. 3/31/2006	15 ft. 3/31/2006	18 ft. 4/11/2006	22 ft. 4/11/2006
1,1-Dichloroethene	0.0072 J	<NA	<NA	<0.01	<0.01
All other VOCs	ND	ND	ND	ND	ND

MW-6	5 ft. 1/31/2006	10 ft. 1/31/2006	15 ft. 1/31/2006	20 ft. 1/31/2006	25 ft. 1/31/2006	30 ft. 1/31/2006
All VOCs	ND	ND	ND	ND	ND	ND

DP0249	1 ft. 4/11/2006	6 ft. 4/11/2006	23 ft. 4/11/2006
All VOCs	ND	ND	ND

DP0196A	20 ft. 4/12/2006	25 ft. 4/12/2006
1,1,1-Trichloroethane	0.0761	<0.01
1,1-Dichloroethane	0.0143	0.0056 J
1,1-Dichloroethene	0.0394	0.0258
Tetrachloroethene	0.0135	<0.01
All other VOCs	ND	ND

DP0196	1 ft. 10/11/2005	5 ft. 10/11/2005	15 ft. 10/11/2005
1,1,1-Trichloroethane	0.0229	0.0673	0.213
1,1-Dichloroethane	<0.01	0.0236	0.0338
1,1-Dichloroethene	<0.01	0.014	0.0705
Tetrachloroethene	<0.01	<0.01	0.0083 J
All other VOCs	ND	ND	ND

DP0172	1 ft. 4/10/2006	6 ft. 4/10/2006	22 ft. 4/10/2006
1,1,1-Trichloroethane	<0.01	0.0055 J	0.0187
1,1-Dichloroethane	<0.01	<0.01	0.0062 J
1,1-Dichloroethene	<0.01	0.0054 J	0.02
All other VOCs	ND	ND	ND

DP0250	2 ft. 4/12/2006	6 ft. 4/12/2006	10 ft. 4/12/2006
1,1,1-Trichloroethane	0.0724	0.0458	0.0614
1,1-Dichloroethane	0.0164	0.0125	0.0163
1,1-Dichloroethene	0.0402	0.0273	0.0422
1,2-Dichloroethane	0.0056 J	<0.01	<0.01
Benzene	<0.01	<0.01	0.0043 J
Tetrachloroethene	0.0089 J	0.0056 J	0.011
Toluene	<0.01	<0.01	0.0044 J
All other VOCs	ND	ND	ND

DP0188	1 ft. 10/10/2005	5 ft. 10/10/2005	10 ft. 10/10/2005	15 ft. 10/10/2005	20 ft. 10/10/2005	25 ft. 10/10/2005
1,1,1-Trichloroethane	3.13	0.27/0.213	0.378	0.037	0.0134	0.0122
1,1,2-Trichloroethane	0.0265	0.0103/0.0091 J	0.0269	<0.01	0.0127	0.0523
1,1-Dichloroethane	0.336	0.0653/0.0453	0.097	0.0074 J	0.0094 J	0.154
1,1-Dichloroethene	0.251	0.0285/0.0192	0.0773	0.006 J	0.009 J	0.132
1,2-Dichloroethane	<0.01	0.0187/0.0153	<0.01	<0.01	<0.01	<0.01
Tetrachloroethene	0.0938	0.0167/0.0119	0.016	<0.01	<0.01	0.0284
Toluene	<0.01	<0.01/<0.01	<0.01	<0.01	<0.01	0.0021 J
All other VOCs	ND	ND/ND	ND	ND	ND	ND

DP0191	1 ft. 10/10/2005	5 ft. 10/10/2005	10 ft. 10/10/2005	15 ft. 10/10/2005	20 ft. 10/10/2005	25 ft. 10/10/2005
1,1,1-Trichloroethane	0.141	0.125	0.0601	0.0058 J	<0.01	0.0208
1,1,2-Trichloroethane	<0.01	<0.01	<0.01	<0.01	<0.01	0.007 J
1,1-Dichloroethane	0.0392	0.0335	0.0242	<0.01	<0.01	0.0355
1,1-Dichloroethene	0.211	0.0561	0.0688	<0.01	<0.01	0.0948
1,2-Dichloroethane	0.0103	0.0092 J	<0.01	<0.01	<0.01	<0.01
Tetrachloroethene	0.0185	0.0095 J	0.0081 J	<0.01	<0.01	0.0088 J
All other VOCs	ND	ND	ND	ND	ND	ND

DP0195	1 ft. 10/11/2005	5 ft. 10/11/2005	15 ft. 10/11/2005
1,1,1-Trichloroethane	0.048	0.0415/0.0459	0.0068 J
1,1-Dichloroethane	0.0111	0.0113/0.012	<0.01
1,1-Dichloroethene	0.128	0.036/0.0417	<0.01
All other VOCs	ND	ND/ND	ND

MW-7	22 ft. 2/1/2006	27 ft. 2/1/2006	30 ft. 2/1/2006
1,1,1-Trichloroethane	<0.01	0.046/0.0664	0.0101
1,1-Dichloroethane	<0.01	0.0245/0.0342	0.0239
1,1-Dichloroethene	<0.01	0.0558/0.0872	0.0786
Tetrachloroethene	<0.01	0.0096 J/0.012	<0.01
All other VOCs	ND	ND/ND	ND

DP0153	1 ft. 9/12/2005	5 ft. 9/12/2005	10 ft. 9/12/2005	10 ft. 10/10/2005	15 ft. 10/10/2005	20 ft. 10/10/2005	25 ft. 10/10/2005
1,1,1-Trichloroethane	0.0371/0.0333	0.0895/0.0695	0.34	0.172	0.0107	0.0249	0.0094 J
1,1,2-Trichloroethane	<0.01/<0.01	<0.01/<0.01	<0.01	<0.01	<0.01	0.0056 J	0.0098 J
1,1-Dichloroethane	0.0116/0.0097 J	0.032/0.0291	0.0855	0.0658	<0.01	0.0291	0.0682
1,1-Dichloroethene	0.0078 J/0.007 J	0.022/0.0158	0.0904	0.0696	<0.01	0.0268	0.1
Tetrachloroethene	0.0099 J/0.0088 J	0.0102/0.0091 J	0.0265	0.0151	<0.01	0.0063 J	0.0101
All other VOCs	ND/ND	ND/ND	ND	ND	ND	ND	ND

DP0194	1 ft. 10/11/2005	5 ft. 10/11/2005	10 ft. 10/11/2005	15 ft. 10/11/2005
1,1,1-Trichloroethane	0.0735	0.05	0.101	0.0425
1,1-Dichloroethane	0.0178	0.0154	0.0338	0.0087 J
1,1-Dichloroethene	0.137	0.0328	0.0743	0.0262
All other VOCs	ND	ND	ND	ND

DP0194A	20 ft. 4/12/2006	22 ft. 4/12/2006	25 ft. 4/12/2006
1,1,1-Trichloroethane	0.0308	0.0758	0.0516/0.0427
1,1,2-Trichloroethane	0.0058 J	0.03	0.0243/0.0283
1,1-Dichloroethane	0.0216	0.0794	0.0615/0.0517
1,1-Dichloroethene	0.0368	0.136	0.112/0.0605
1,2-Dichloroethane	<0.01	0.007 J	0.0058 J/0.0061 J
Tetrachloroethene	0.0059 J	0.0164	0.0142/0.0067 J
All other VOCs	ND	ND	ND/ND

DP0198	1 ft. 10/18/2005	5 ft. 10/18/2005	15 ft. 10/18/2005
1,1,1-Trichloroethane	0.0195	0.0108	<0.01
1,1-Dichloroethane	0.0052 J	<0.01	<0.01
1,1-Dichloroethene	0.202	0.0225	<0.01
All other VOCs	ND	ND	ND

DP0198A	20 ft. 4/11/2006	25 ft. 4/11/2006
1,1,1-Trichloroethane	<0.01/<0.01	0.0097 J
1,1-Dichloroethane	<0.01/<0.01	0.0124
1,1-Dichloroethene	<0.01/<0.01	0.0334
All other VOCs	ND/ND	ND

DP0173	1 ft. 4/10/2006	7 ft. 4/10/2006	22 ft. 4/10/2006
1,1,1-Trichloroethane	0.025	0.0176	0.0183/0.0093 J
1,1-Dichloroethane	<0.01	<0.01	0.0145/0.0072 J
1,1-Dichloroethene	0.0278	0.0161	0.0497/0.0148
All other VOCs	ND	ND	ND/ND

DP0217	1 ft. 10/28/2005	5 ft. 10/28/2005	10 ft. 10/28/2005	15 ft. 10/28/2005	20 ft. 10/28/2005	23 ft. 10/28/2005	25 ft. 10/28/2005
1,1,1-Trichloroethane	<0.01/0.0056 J	0.0081 J	0.0121	<0.01	<0.01	<0.01	<0.01
1,1-Dichloroethane	<0.01/<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	0.0315
1,1-Dichloroethene	0.0086 J/0.0139	0.0188	0.0345	0.01	0.0068 J	<0.01	0.124
All other VOCs	ND/ND	ND	ND	ND	ND	ND	ND

MW-8	8 ft. 2/1/2006	17 ft. 2/1/2006	20 ft. 2/1/2006	25 ft. 2/1/2006	32 ft. 2/1/2006
1,1,1-Trichloroethane	0.0058 J	<0.01	0.0088 J	<0.01	<0.01
1,1-Dichloroethane	<0.01	<0.01	0.0055 J	0.0099 J	0.0223
1,1-Dichloroethene	0.0153	<0.01	0.0225	0.0321	0.0686
All other VOCs	ND	ND	ND	ND	ND

DP0152	1 ft. 9/12/2005	5 ft. 9/12/2005	10 ft. 9/12/2005
1,1,1-Trichloroethane	0.0056 J	<0.01	0.0079 J
1,1-Dichloroethane	<0.01	<0.01	0.0066 J
1,1-Dichloroethene	0.0092 J	0.0068 J	0.0207
All other VOCs	ND	ND	ND

DP0129	1 ft. 9/7/2005	5 ft. 9/9/2005	10 ft. 9/9/2005	15 ft. 10/28/2005	20 ft. 10/28/2005	25 ft. 10/28/2005
1,1,1-Trichloroethane	<0.01	<0.005/<0.005	0.009 J	<0.01	<0.01/<0.01	0.0064 J
1,1-Dichloroethane	<0.01	<0.005/<0.005	0.0056 J	<0.01	<0.01/<0.01	0.006 J
1,1-Dichloroethene	<0.01	0.0056 J/<0.005	0.0211	<0.01	<0.01/<0.01	0.0342
Benzene	<0.01	<0.002/<0.002	0.002 J	<0.01	<0.01/<0.01	<0.01
Toluene	<0.01	<0.002/<0.002	0.002 J	<0.01	<0.01/<0.01	<0.01
All other VOCs	ND	ND/ND	ND	ND	ND/ND	ND

DP0160	2 ft. 3/27/2006	7 ft. 3/27/2006	25 ft. 3/27/2006
1,1-Dichloroethene	<0.01	<0.01	0.0064 J
All other VOCs	ND	ND	ND

MW-9	1 ft. 2/2/2006	5 ft. 2/2/2006	10 ft. 2/2/2006	15 ft. 2/2/2006	20 ft. 2/2/2006	25 ft. 2/2/2006	30 ft. 2/2/2006
1,1-Dichloroethene	<0.01	<0.01	<0.01/<0.01	<0.01	<0.01	0.0154	0.0563/0.0514
All other VOCs	ND	ND	ND/ND	ND	ND	ND	ND/ND

DP0183	0 ft. 9/14/2005	1 ft. 9/14/2005	5 ft. 9/14/2005	10 ft. 9/14/2005
1,1,1-Trichloroethane	0.0149	0.0272/<0.01	<0.01	<0.01
1,1-Dichloroethane	0.0159	0.0208/<0.01	<0.01	<0.01
1,1-Dichloroethene	0.0519	0.0796/0.0052 J	0.0101	0.007 J
All other VOCs	ND	ND/ND	ND	ND

DP0161	0 ft. 4/12/2006	1 ft. 4/12/2006	6 ft. 4/12/2006	22 ft. 4/12/2006	23 ft. 4/12/2006
1,1,1-Trichloroethane	<0.01	0.0409/0.0394	<0.01	<0.01	<0.01
1,1-Dichloroethane	<0.01	0.011/0.013	<0.01	<0.01	<0.01
1,1-Dichloroethene	<0.01	0.0497/0.0674	<0.01	0.0153	0.0214
1,2,3-Trichlorobenzene	<0.01	0.0188/0.0152	<0.01	<0.01	<0.01
1,2,4-Trichlorobenzene	<0.01	0.0622/0.0541	<0.01	<0.01	<0.01
1,2,4-Trimethylbenzene	<0.01	0.0097 J/0.0132	<0.01	<0.01	<0.01
1,3,5-Trimethylbenzene	<0.01	<0.01/0.0054 J	<0.01	<0.01	<0.01
Benzene	<0.01	<0.01/<0.01	0.0084 J	<0.01	<0.01
Cymene	<0.01	0.0114/0.019	<0.01	<0.01	<0.01
Toluene	<0.01	0.0022 J/0.0026 J	0.007 J	<0.01	<0.01
All other VOCs	ND	ND/ND	ND	ND	ND

DP0170	2 ft. 4/12/2006	7 ft. 4/12/2006	15 ft. 4/12/2006	22 ft. 4/12/2006
1,1-Dichloroethene	<0.01	<0.01	<0.01	0.0102
All other VOCs	ND	ND	ND	ND

DP0098	1 ft. 9/1/2005
All VOCs	ND

DP0137	5 ft. 9/12/2005	10 ft. 9/12/2005
All VOCs	ND	ND

DP0138	5 ft. 9/12/2005	10 ft. 9/12/2005
All VOCs	ND	ND

DP0140	1 ft. 9/12/2005
All VOCs	ND

DP0010	1 ft. 8/29/2005
All VOCs	ND

DP0167	0 ft. 4/12/2006	1 ft. 4/12/2006	7 ft. 4/12/2006	15 ft. 4/12/2006	23 ft. 4/12/2006
1,1-Dichloroethene	<0.01	0.0054	<0.01	<0.01	0.0072
All other VOCs	ND	ND	ND	ND	ND

DP0139	1 ft. 9/12/2005
All VOCs	ND

DP0011	1 ft. 8/29/2005
All VOCs	ND

DP0012	1 ft. 8/29/2005
All VOCs	ND

DP0218	1 ft. 10/28/2005	5 ft. 10/28/2005	10 ft. 10/28/2005	15 ft. 10/28/2005	20 ft. 10/28/2005	25 ft. 10/28/2005
1,1-Dichloroethene	<0.01	0.0055 J/<0.01	0.0092 J	<0.01	<0.01	0.0222
All other VOCs	ND	ND/ND	ND	ND	ND	ND

DP0009	1 ft. 8/29/2005	5 ft. 9/9/2005	10 ft. 9/9/2005
1,1,1-Trichloroethane	0.0058 J	0.0112	<0.005
1,1-Dichloroethane	0.0093 J	0.0219	0.0123
Benzene	<0.01	<0.002	0.002 J
All other VOCs	ND	ND	ND

DP0166	0 ft. 4/12/2006	1 ft. 4/12/2006	9 ft. 4/12/2006	16 ft. 4/12/2006	23 ft. 4/12/2006
1,1-Dichloroethene	<0.01	<0.01	0.0071 J	<0.01	0.008 J
All other VOCs	ND	ND	ND	ND	ND

DP0128	1 ft. 9/7/2005	5 ft. 9/9/2005	10 ft. 9/9/2005
1,1,1-Trichloroethane	<0.01/<0.01	0.0083 J	<0.005
1,1-Dichloroethane	0.0059 J/<0.01	0.0233	0.0158
Benzene	<0.01/<0.01	<0.002	0.0029 J
Toluene	<0.01/<0.01	<0.002	0.0025 J
All other VOCs	ND/ND	ND	ND

DP0104	5 ft. 9/1/2005	15 ft. 9/1/2005
All VOCs	ND	ND

DP0219	1 ft. 10/28/2005	5 ft. 10/28/2005	10 ft. 10/28/2005	15 ft. 10/28/2005	20 ft. 10/28/2005	25 ft. 10/28/2005
1,1-Dichloroethene	0.0138	<0.01	0.0055 J/<0.01	<0.01	<0.01	0.0093 J
All other VOCs	ND	ND	ND/ND	ND	ND	ND

DP0215	1 ft. 10/28/2005	5 ft. 10/28/2005	10 ft. 10/28/2005	15 ft. 10/28/2005	17 ft. 10/28/2005	20 ft. 10/28/2005	25 ft. 10/28/2005
1,1,1-Trichloroethane	0.0107	0.0128	0.0228	<0.01	0.0113	<0.01	0.0124
1,1-Dichloroethane	<0.01	0.0066 J	0.0109	<0.01	<0.01	<0.01	0.0142
1,1-Dichloroethene	0.0084 J	0.0186	0.0313	<0.01	<0.01	0.0068 J	0.0841
All other VOCs	ND	ND	ND	ND	ND	ND	ND

DP0107	5 ft. 9/1/2005
All VOCs	ND

DP0187	1 ft. 9/14/2005	5 ft. 9/14/2005	10 ft. 9/14/2005
1,1,1-Trichloroethane	0.0079 J	0.0081 J	<0.01
1,1-Dichloroethene	<0.01	0.0059 J	<0.01
All other VOCs	ND	ND	ND

DP0108	5 ft. 9/1/2005
All VOCs	ND

GS0002	2 ft. 9/16/2005
All VOCs	ND

DP0060	5 ft. 8/30/2005	15 ft. 8/30/2005
1,1,1-Trichloroethane	<0.01	0.0081 J
1,1-Dichloroethane	<0.01	0.005 J
1,1-Dichloroethene	<0.01	0.0079 J
Tetrachloroethene	0.0088 J	<0.01
All other VOCs	ND	ND

DP0220	1 ft. 10/28/2005	5 ft. 10/28/2005	10 ft. 10/28/2005	15 ft. 10/28/2005	20 ft. 10/28/2005	25 ft. 10/28/2005
1,1,1-Trichloroethane	<0.01	<0.01/<0.01	0.0087 J	<0.01	<0.01	<0.01
1,1-Dichloroethane	<0.01	<0.01/<0.01	0.0066 J	<0.01	<0.01	0.0131
1,1-Dichloroethene	<0.01	<0.01/<0.01	0.019	<0.01	0.0056 J	0.0467
All other VOCs	ND	ND/ND	ND	ND	ND	ND

DP0193	1 ft. 10/10/2005	5 ft. 10/10/2005	10 ft. 10/10/2005	15 ft. 10/10/2005	20 ft. 10/10/2005	25 ft. 10/10/2005
1,1,1-Trichloroethane	0.0308	0.0233	0.0404	0.0084 J	0.0052 J	0.0108
1,1,2-Trichloroethane	<0.01	<0.01	<0.01	<0.01	<0.01	0.0061 J
1,1-Dichloroethane	<0.01	0.0089 J	0.0156	<0.01	<0.01	0.0414
1,1-Dichloroethene	0.0088 J	0.0067 J	0.0181	<0.01	0.0066 J	0.0905
Dibromomethane	0.0308	<0.01	<0.01	<0.01	<0.01	<0.01
Tetrachloroethene	0.0086 J	<0.01	<0.01	<0.01	<0.01	<0.01
All other VOCs	ND	ND	ND	ND	ND	ND

DP0190	1 ft. 10/10/2005	5 ft. 10/10/2005	10 ft. 10/10/2005	15 ft. 10/10/2005	20 ft. 10/10/2005	25 ft. 10/10/2005
1,1,1-Trichloroethane	0.016	0.0565/0.0425	0.0813	0.0142	<0.01	0.0082 J
1,1,2-Trichloroethane	<0.01	<0.01/<0.01	<0.01	<0.01	<0.01	0.0221
1,1-Dichloroethane	<0.01	0.0213/0.0152	0.0321	<0.01	<0.01	0.0749
1,1-Dichloroethene	<0.01	0.0261/0.0182	0.0425	0.0053 J	<0.01	0.0974
Tetrachloroethene	<0.01	<0.01/<0.01	<0.01	<0.01	<0.01	0.0057 J
All other VOCs	ND	ND/ND	ND	ND	ND	ND

DP0135	1 ft. 9/9/2005	5 ft. 9/9/2005	10 ft. 9/9/2005	15 ft. 9/9/2005
1,1,1-Trichloroethane	0.023	0.0352/0.0326	0.0952	0.0089 J
1,1-Dichloroethane	0.0051 J	0.0148/0.0127	0.0388	<0.01
1,1-Dichloroethene	0.0134	0.0159/0.0153	0.0599	<0.01
Benzene	<0.01	0.0046 J/0.0041 J	<0.002	<0.01
Tetrachloroethene	<0.01	0.0058 J/<0.005	0.0079 J	<0.01
Toluene	<0.01	0.0034 J/0.003 J	<0.002	<0.01
All other VOCs	ND	ND/ND	ND	ND

MW-5	10 ft. 1/31/2006	15 ft. 1/31/2006	20 ft. 1/31/2006	25 ft. 1/31/2006	30 ft. 1/31/2006
1,1-Dichloroethene	<0.01	<0.01	0.0059 J	0.0209	<0.01
All other VOCs	ND	ND	ND	ND	ND

DP0134	1 ft. 9/9/2005	5 ft. 9/9/2005	10 ft. 9/9/2005	15 ft. 9/9/2005
1,1,1-Trichloroethane	0.0406	0.0253	0.0576	0.0052 J
1,1-Dichloroethane	0.0136	0.0095 J	0.0275	<0.01
1,1-Dichloroethene	0.0276	0.0164	0.0475	<0.01
Benzene	<0.01	0.0037 J	<0.01	<0.01
Tetrachloroethene	0.0069 J	<0.01	<0.01	<0.01
Toluene	<0.01	0.0028 J	<0.01	<0.01
All other VOCs	ND	ND	ND	ND

DP0216	1 ft. 10/28/2005	5 ft. 10/28/2005	10 ft. 10/28/2005	15 ft. 10/28/2005	20 ft. 10/28/2005	25 ft. 10/28/2005	30 ft. 10/28/2005
1,1,1-Trichloroethane	0.0083 J	<0.01	0.0123	<0.01	0.0076 J	0.0075 J	<0.01
1,1-Dichloroethane	<0.01	<0.01	0.0086 J	<0.01	0.0102	0.0311	0.0053 J
1,1-Dichloroethene	0.0085 J	<0.01	0.0121	<0.01	0.0223	0.0827	0.0489
All other VOCs	ND	ND	ND	ND	ND	ND	ND

DP0111	1 ft. 9/1/2005
1,1,1-Trichloroethane	0.0103
All other VOCs	ND

DP0133	1 ft. 9/9/2005	5 ft. 9/9/2005	10 ft. 9/9/2005
1,1,1-Trichloroethane	0.0446	0.0468	0.0765
1,1-Dichloroethane	0.0117	0.0219	0.0283
1,1-Dichloroethene	0.0116	0.0163	0.0137
Benzene	<0.01	0.0021 J	<0.01
Tetrachloroethene	0.0104	0.0072 J	0.0154
All other VOCs	ND	ND	ND

DP0005	1 ft. 8/25/2005	4 ft. 8/25/2005
1,1,1-Trichloroethane	0.0241	<0.01
All other VOCs	ND	ND

DP0189	1 ft. 10/10/2005	5 ft. 10/10/2005	10 ft. 10/10/2005	15 ft. 10/10/2005	20 ft. 10/10/2005	25 ft. 10/10/2005
1,1,1-Trichloroethane	0.0267	0.1	0.161	0.0503	0.0074 J	0.0082 J
1,1,2-Trichloroethane	<0.01	<0.01	0.0128	0.0057 J	<0.01	<0.01
1,1-Dichloroethane	0.0079 J	0.0552	0.0795	0.0151	<0.01	0.0231
1,1-Dichloroethene	0.0071 J	0.0346	0.0555	0.006 J	<0.01	0.0423
Tetrachloroethene	<0.01	0.0077 J	0.012	0.0054 J	<0.01	<0.01
All other VOCs	ND	ND	ND	ND	ND	ND

DP0059	1 ft. 9/2/2005
1,1,1-Trichloroethane	0.0058 J/<0.01
Benzene	<0.01/0.002 J
All other VOCs	ND/ND

DP0192	1 ft. 10/10/2005	5 ft. 10/10/2005	10 ft. 10/10/2005	15 ft. 10/10/2005	20 ft. 10/10/2005	25 ft. 10/10/2005
1,1,1-Trichloroethane	0.0143	0.0173/0.0085 J	0.022	0.0308	0.0098 J	<0.01
1,1-Dichloroethane	0.0125	0.0115/<0.01	0.0193	0.0131	0.0129	0.0138
1,1-Dichloroethene	0.0123	0.0066 J/<0.01	0.0174	0.0088 J	0.0097 J	0.0152
Tetrachloroethene	0.0058 J	<0.01/<0.01	<0.01	<0.01	<0.01	<0.01
All other VOCs	ND	ND/ND	ND	ND	ND	ND

DP0159	0 ft. 4/10/2006	1 ft. 4/10/2006
All VOCs	ND	ND

GS0021	0 ft. 9/27/2005	2 ft. 9/22/2005
1,1,1-Trichloroethane	0.012	<0.01
1,1-Dichloroethane	0.0229	<0.01
1,1-Dichloroethene	0.0322	<0.01
All other VOCs	ND	ND

DP0130	1 ft. 9/9/2005	5 ft. 9/9/2005
All VOCs	ND	ND

DP0006	1 ft. 8/25/2005
All VOCs	ND

DP0007	1 ft. 8/25/2005
Benzene	0.0022 J/<0.01
All other VOCs	ND/ND

DP0131	1 ft. 9/9/2005	5 ft. 9/9/2005
All VOCs	ND	ND

DP0158	0 ft. 4/10/2006	1 ft. 4/10/2006
1,1,1-Trichloroethane	0.0174	<0.01
1,1-Dichloroethane	0.0063 J	<0.01
1,1-Dichloroethene	0.0139	<0.01
Naphthalene	0.0271	<0.01
Tetrachloroethene	0.0089 J	<0.01
Toluene	0.0139	<0.01
All other VOCs	ND	ND

GS0023	0 ft. 9/22/2005	1 ft. 9/22/2005
1,1,1-Trichloroethane	0.0131	<0.01
1,1-Dichloroethane	0.0151	<0.01
1,1-Dichloroethene	0.024	<0.01
All other VOCs	ND	ND

GS0001	0 ft. 9/16/2005	3 ft. 9/16/2005	5 ft. 9/16/2005
1,1-Dichloroethane	0.024	<0.01	<0.01
1,1-Dichloroethene	0.0218	<0.01	<0.01
2-Butanone	0.036 J	0.0811	0.031 J
Acetone	0.184	1.34	0.605
Naphthalene	0.0157	<0.01	<0.01
Toluene	0.0028 J	<0.01	<0.01
All other VOCs	ND	ND	ND

GS0024	0 ft. 9/22/2005	2 ft. 9/22/2005
1,1,1-Trichloroethane	0.122/0.0701	<0.01
1,1-Dichloroethane	0.0595/0.0372	<0.01
1,1-Dichloroethene	0.16/0.125	<0.01
All other VOCs	ND/ND	ND

DP0157	0 ft. 4/10/2006	1 ft. 4/10/2006
1,1,1-Trichloroethane	0.0997	0.103
1,1-Dichloroethane	0.0684	0.0156
1,1-Dichloroethene	0.175	0.0557
Toluene	0.0055 J	0.0048 J
All other VOCs	ND	ND

DP0157B	1 ft. 4/20/2006
1,1,1-Trichloroethane	0.0171
1,1-Dichloroethane	0.0125
1,1-Dichloroethene	0.0106
1,2,4-Trimethylbenzene	0.0088 J
Naphthalene	0.0216
All other VOCs	ND

DP0013	1 ft. 8/29/2005
All VOCs	ND

DP0004	5 ft. 8/29/2005	15 ft. 8/25/2005
All VOCs	ND	ND

LEGEND:

- (green dot) SOIL VOC SAMPLING LOCATION AT WHICH CONCENTRATIONS OF CHEMICALS ANALYZED ARE LESS THAN PROPOSED INDUSTRIAL RISK-BASED REMEDIATION CRITERIA.
- (red dot) SOIL VOC SAMPLING LOCATION AT WHICH CONCENTRATIONS OF CHEMICALS ANALYZED ARE GREATER THAN PROPOSED INDUSTRIAL RISK-BASED OR GROUNDWATER PROTECTION REMEDIATION CRITERIA.
- (1) AOI LOCATION

NOTES:

1. RESULTS IN RED ARE GREATER THAN THE PROPOSED INDUSTRIAL RISK-BASED SOIL OR GROUNDWATER PROTECTION REMEDIATION CRITERIA.
2. MOST VOC CONCENTRATIONS IN THE SOIL MATRIX DO NOT WARRANT REMEDIATION BASED ON THE REMEDIATION CRITERIA DERIVED FROM THE HUMAN HEALTH RISK ASSESSMENT.
3. COMPOUNDS SHOWN IN DATA BOXES ARE THOSE THAT WERE DETECTED ABOVE REPORTING LIMITS FOR EACH LOCATION.
4. UNITS ARE IN MG/KG.

Compound	Human Health Criteria (mg/kg)	Groundwater Protection (mg/kg)
1,1,1-Trichloroethane	–	0.665
1,1,2-Trichloroethane	–	0.017
1,1-Dichloroethane	–	0.017
1,1-Dichloroethene	–	0.020
1,2-Dichloroethane	–	0.02
1,2,4-Trimethylbenzene	0.062	–
1,2,4-Trichlorobenzene	–	0.017
1,3,5-Trimethylbenzene	0.034	–
Benzene	–	0.015
cis-1,2-Dichloroethene	–	0.020
Ethylbenzene	–	2.389
Naphthalene	0.174	–
Tetrachlorethene	–	0.017
Toluene	–	0.635
Xylenes	–	6.372

N / S / E / W

0 50 100 150 200

SCALE IN FEET

HALEY & ALDRICH

DELPHI CORPORATION
FORMER BATTERY OPERATIONS, 1201 N. MAGNOLIA
ANAHEIM, CALIFORNIA
32486-009

SOIL SAMPLES EXCEEDING SOIL HUMAN HEALTH AND/OR GROUNDWATER PROTECTION CRITERIA - WEST

SCALE: AS SHOWN
AUGUST 2007

FIGURE 28

G:\32486\011-CMP-CORRECTIVE MEASURES PROPOSAL\CAD\32486-SOILDATAVOC_GWP_ALTERNATE_R2.DWG