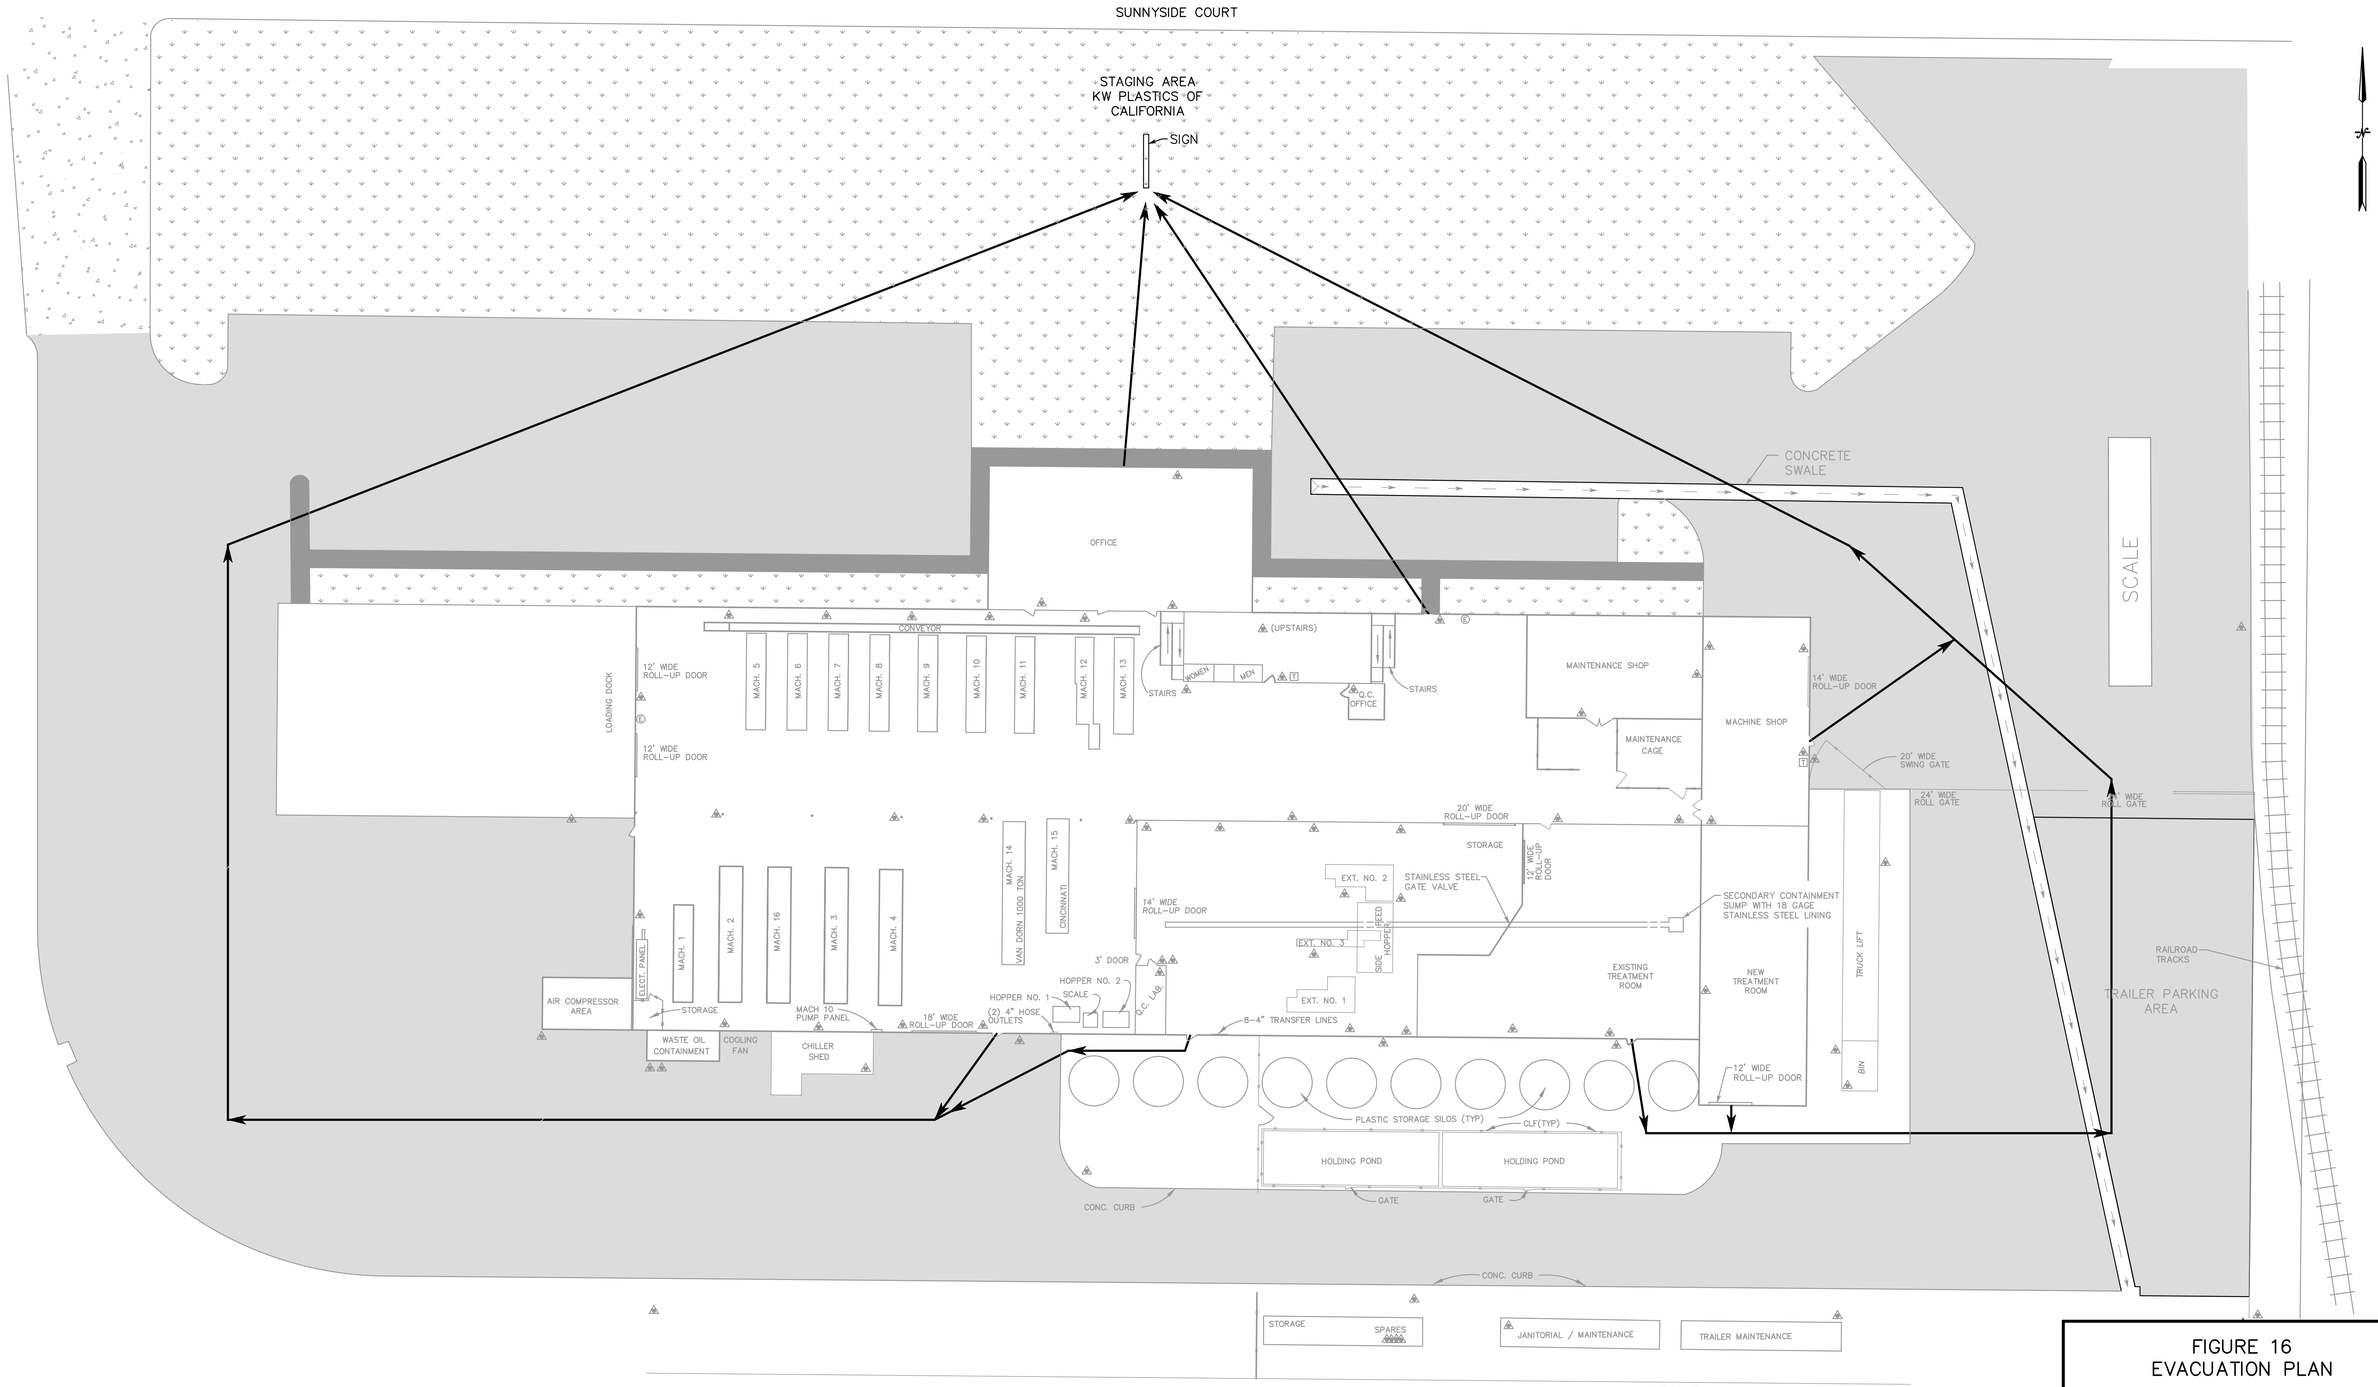

LEGEND

ALL FIRE EXTINGUISHERS ASSOCIATED WITH THE NEW TREATMENT SYSTEM WILL BE LOCATED AFTER INSTALLATION OF THE TANKS IS COMPLETED.

LEGEND

- FIRE EXTINGUISHER LOCATION
- TELEPHONE LOCATION
- EYEWASH LOCATION
- IRRIGATED LAWN
- ASPHALT
- CONCRETE
- DRAINAGE DITCH
- EVACUATION ROUTE

0 10 20 40
SCALE: 1" = 20'

FIGURE 16
EVACUATION PLAN

RCRA CLASS 3 PERMIT MODIFICATION
KW PLASTICS OF CALIFORNIA
BAKERSFIELD, CALIFORNIA

SCALE: 1' = 20' | DR ALW | CHK JLL | REV MAH

PREPARED BY:

TriAD ENVIRONMENTAL CONSULTANTS, INC.
Suite 200, 207 Donelson Pike, Nashville, Tn 37214
615-889-6888 fax 615-889-4004

PROJ: 96-SAN01-05 | DATE: 04/28/06 | SHEET 1 OF 1

0105-15-EVACUATION-PLAN.DWG