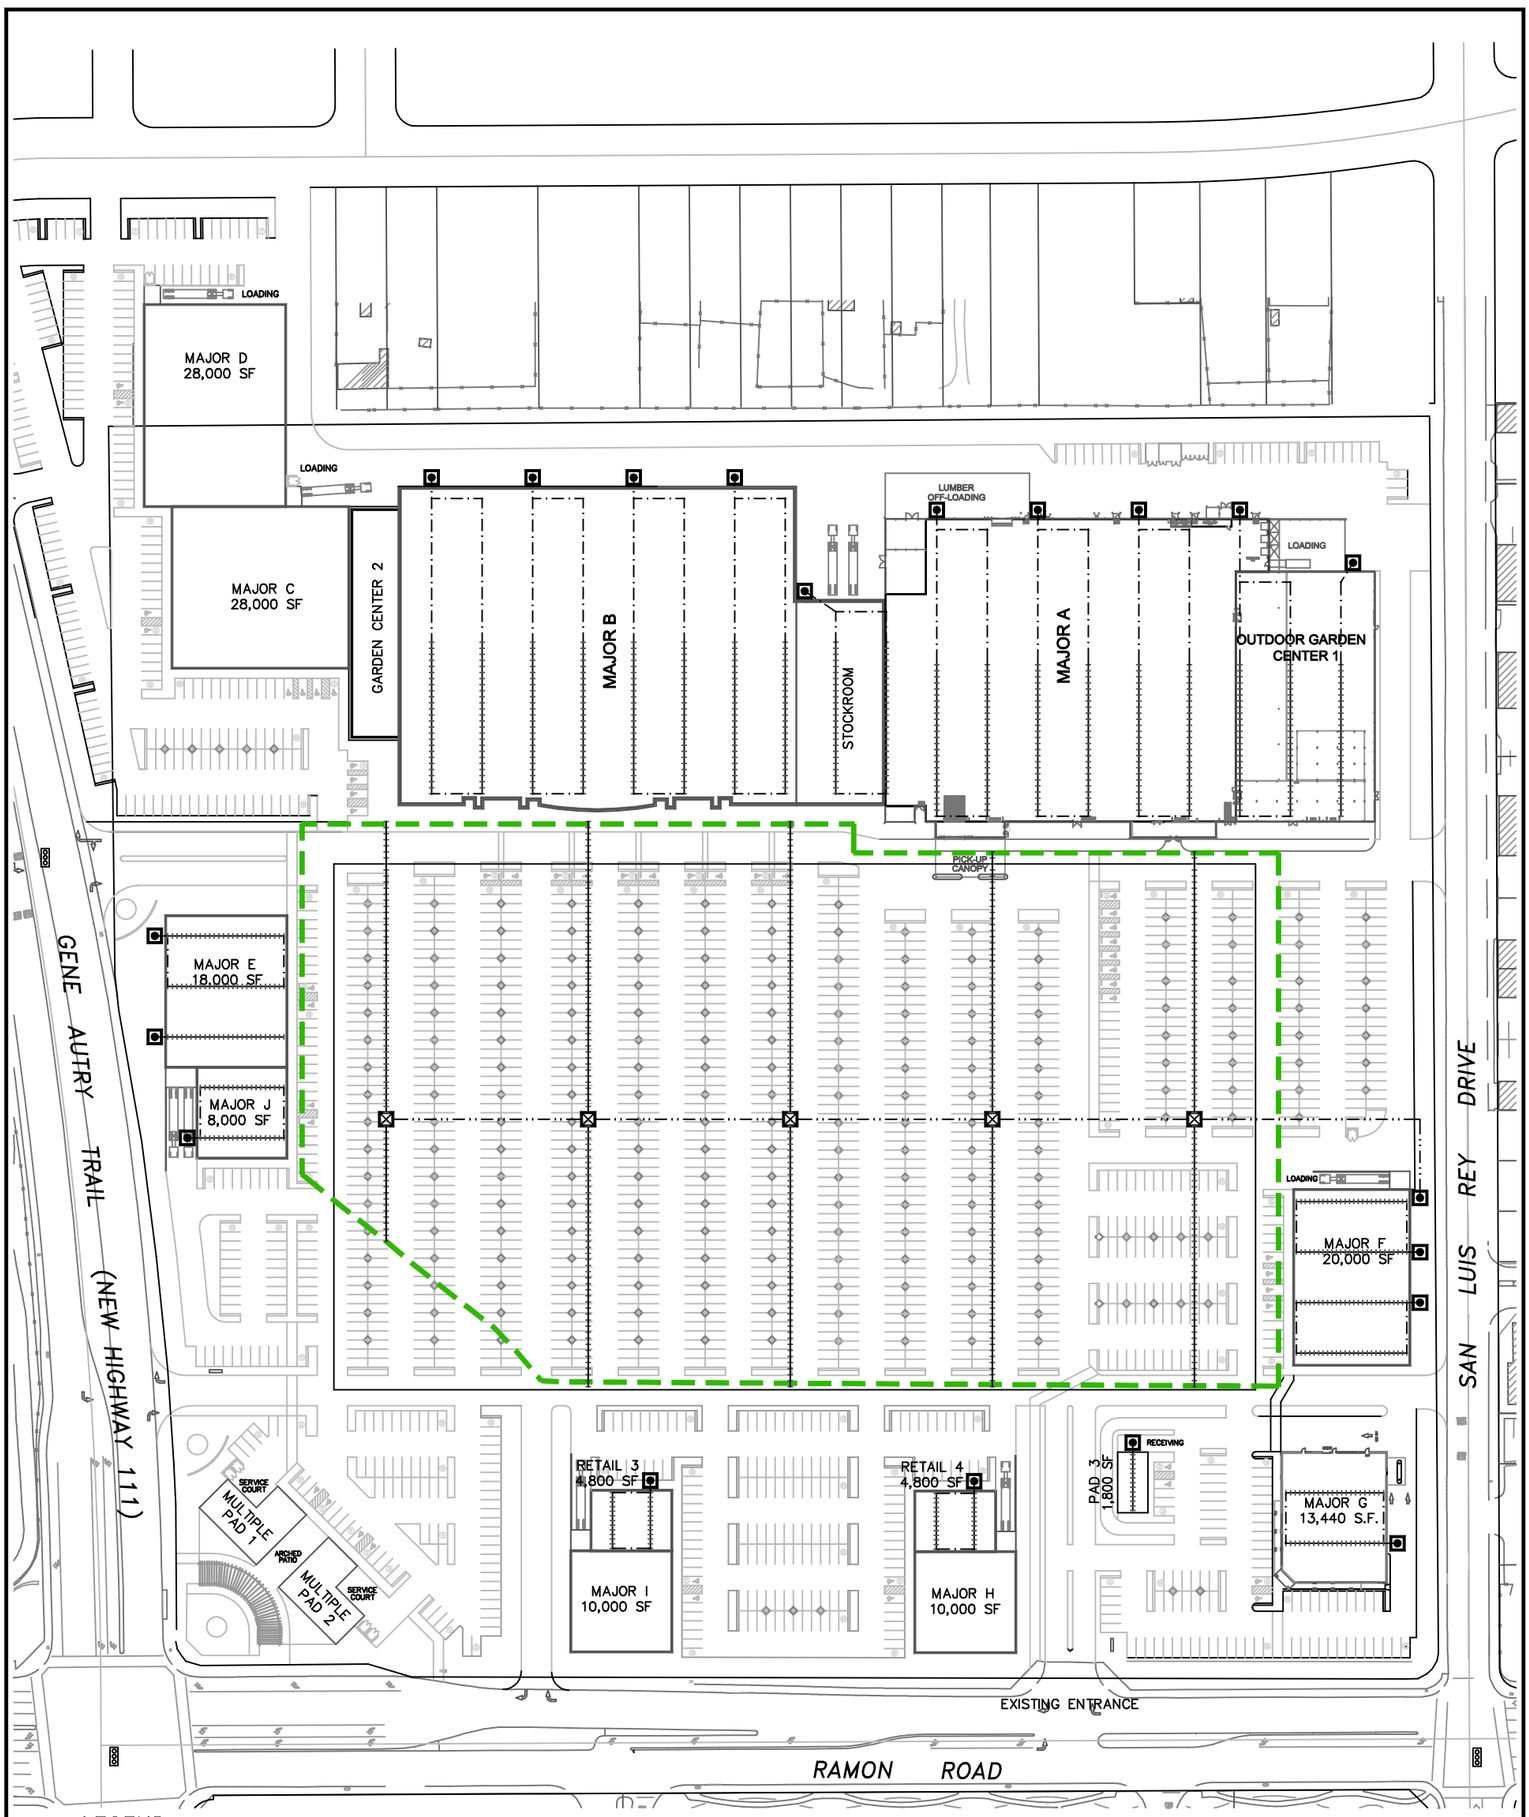

LEGEND

- PROPOSED LIMITS OF BURIED DEBRIS
- 4–INCH SCH 40 PVC SLOTTED (0.02–INCH, MIN. 5 FEET FROM BUILDING WALLS) (SEE DETAIL B6, FIGURE 6)
- 4–INCH SCH 40 BLANK PVC, ALL HEADER LINES AND 5–FOOT LONG SECTIONS OF PIPING BENEATH BUILDINGS (AND FROM BUILDING WALLS) (SEE DETAIL B6, FIGURE 6)
- 6–INCH SCH 40 BLANK PVC TRUNK LINE, PIPING BENEATH LANDFILL DEBRIS (SEE DETAIL C6, FIGURE 6)
- VAULT CONTAINING HEADER LINE(S), VALVE(S), AND 4–INCH SCH 40 BLANK ROOF LEVEL RISERS (SEE DETAIL A6, FIGURE 6)
- VAULT CONTAINING 6–INCH TRUNK LINE, HEADER LINES, VALVES, VACUUM GAUGES, PORTS FOR PITOT TUBES, AND SAMPLE PORTS (SEE DETAIL C6, FIGURE 6)

N

0 150 300

APPROXIMATE SCALE IN FEET

NOTES:

1. INFORMATION FOR THIS DRAWING WAS OBTAINED IN PART FROM: PREVIOUS SKETCHES. DIMENSIONS AND BEARINGS NEED TO BE VERIFIED
2. CONTRACTOR TO PROVIDE PASSIVE VAPOR COLLECTION SYSTEM PARTS AND EQUIPMENT PER ATTACHED LIST OF MATERIALS.
3. PASSIVE VAPOR COLLECTION SYSTEM TO BE INSTALLED PER ATTACHED DESIGN SPECIFICATIONS.

DATE:	FILE NAME:	PROJECT NO.:
10/03	SSP-19B.VAPSYS	

VAPOR RECOVERY PIPING LAYOUT

PROPOSED SHOPPING CENTER DEVELOPMENT
EXCEL PROPERTY MANAGEMENT SERVICES, INC.
N.E.C. GENE AUTRY TRAIL AND RAMON ROAD

The Source Group, Inc.

FIGURE: 5

SSP–19B\VAPSYS.1003-3.DWG (1:1)